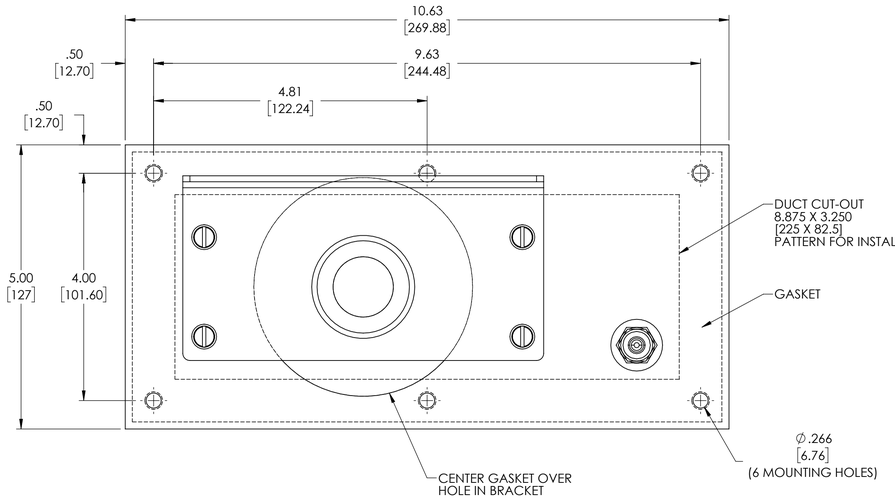

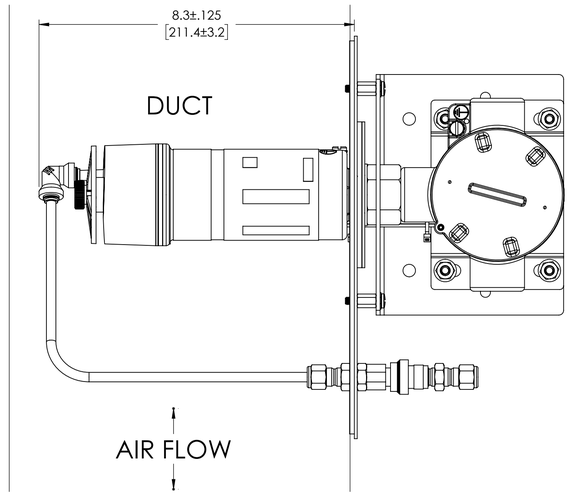

JB5000 WITH XIR PLUS
MOUNTED IN DUCT
(SENSOR MUST BE MOUNTED IN HORIZONTAL POSITION)

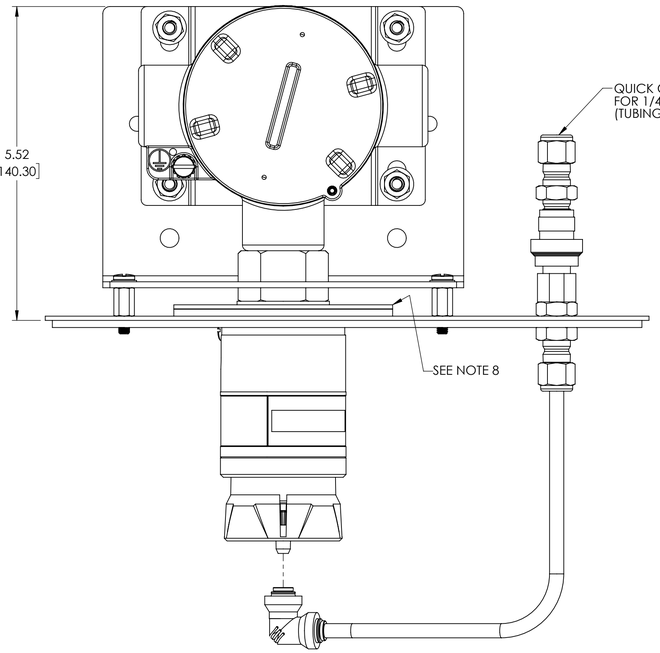

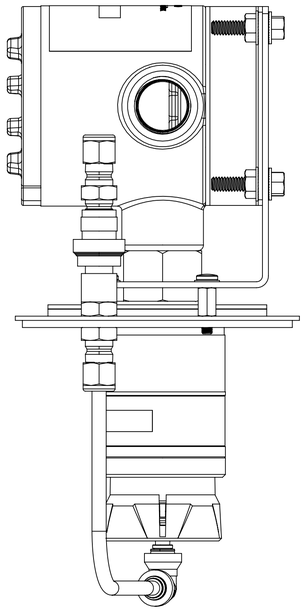

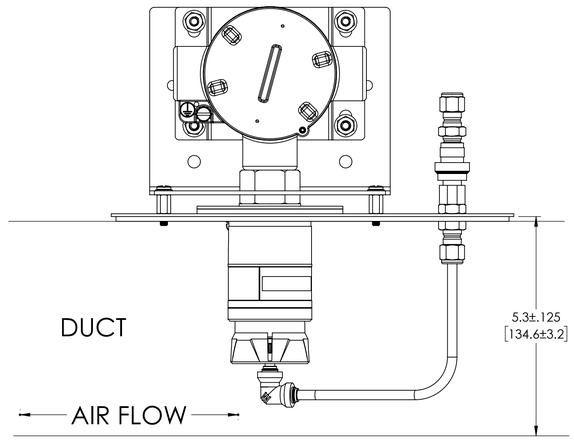

JB5000 WITH XCELL SENSOR
MOUNTED IN DUCT
SENSOR MUST BE MOUNTED IN VERTICAL POSITION

NOTES:
1. CUSTOMER MUST PROVIDE FLEXIBLE WIRING CONNECTION TO CONDUIT TO RELIEVE STRAIN.
2. DIMENSIONS SHOWN IN INCHES AND [MILLIMETERS].
3. APPROX. WEIGHT (DUCT MOUNT KIT ONLY) 3 LBS. [1.4 KILOGRAMS]
4. DUCT KIT IS 316 STAINLESS STEEL CONSTRUCTION WITH STAINLESS STEEL HARDWARE.
5. JB5000, SENSOR AND CONDUIT ARE NOT INCLUDED IN THE KIT.
6. REFER TO MANUAL 10177361 AND INSTALLATION INSTRUCTIONS 10180897.
7. TEMPERATURE RANGE (DUCT MOUNT KIT ONLY) -40°F TO +194°F [-40°c TO 90°C]. REFER TO MANUAL FOR TEMPERATURE RANGE OF INDIVIDUAL SENSOR TYPES.
8. USE SENSOR PLATE AND GASKET AS PROVIDED IN KIT.

REVISIONS

LIFECYCLE STATE	REVISION
Production	**0**

MSA The Safety Company — www.MSAsafety.com

THIS DRAWING IS THE PROPERTY OF MSA - THE SAFETY COMPANY AND IS MADE AVAILABLE TO YOU IN CONFIDENCE AND SUBJECT TO THE FOLLOWING: NO PERMISSION IS GRANTED TO PUBLISH, USE, REPRODUCE, TRANSMIT OR DISCLOSE THIS DRAWING, OR ANY INFORMATION CONTAINED THEREIN TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF MSA - THE SAFETY COMPANY EXCEPT FOR THE MANUFACTURE OF ARTICLES FOR MSA - THE SAFETY COMPANY.

THIRD-ANGLE PROJECTION

DO NOT SCALE DWG.

MSA STANDARD SHOP PRACTICES APPLY

CODE SYMBOLS
CRITICAL (+) MINOR (NO MARK)
MAJOR A (A)
MAJOR B (B)
100 % INSPECTION (C)

TOLERANCES UNLESS OTHERWISE SPECIFIED
FRACTIONAL ± 1/64
2 PL DEC. ± 0.01
3 PL DEC. ± 0.005
ANGULAR ± 1 DEG.
SEE MSA STANDARD SHOP PRACTICES FOR DRILLED HOLE TOLERANCES

JOB NO. 800000049470
APPROVAL AGENCY CODE:
NIOSH ATTR. DOC.:

		DATE
DRAWN BY	WJE	7-20-2021
CHECKED BY	J.HAVERSTICK	7-27-2021
PROJECT ENGR.	J.HAVERSTICK	7-27-2021
QUALITY ASSURANCE	J.HOFFMAN	7-26-2021
MANUFACTURING	S.HALBROCK	7-26-2021

INSTALLATION OUTLINE, RECTANGULAR DUCT MOUNT KIT, JB5000

CADD REF: SK3015-1068
SCALE: 1:4

SHEET SIZE **D**
SK3015-1068
SHEET 1 OF 1